

FIG. 1
(PRIOR ART)

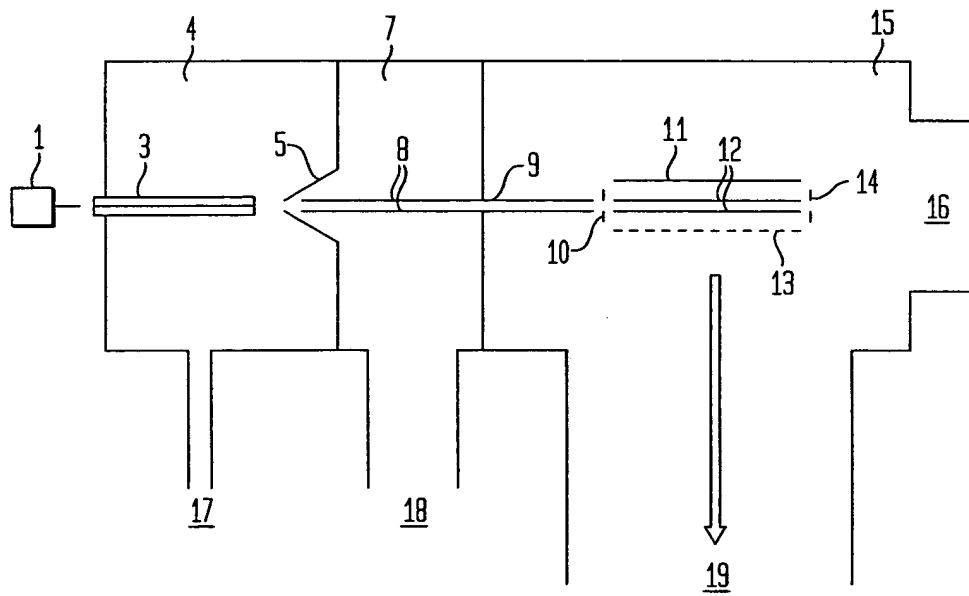


FIG. 2
(PRIOR ART)

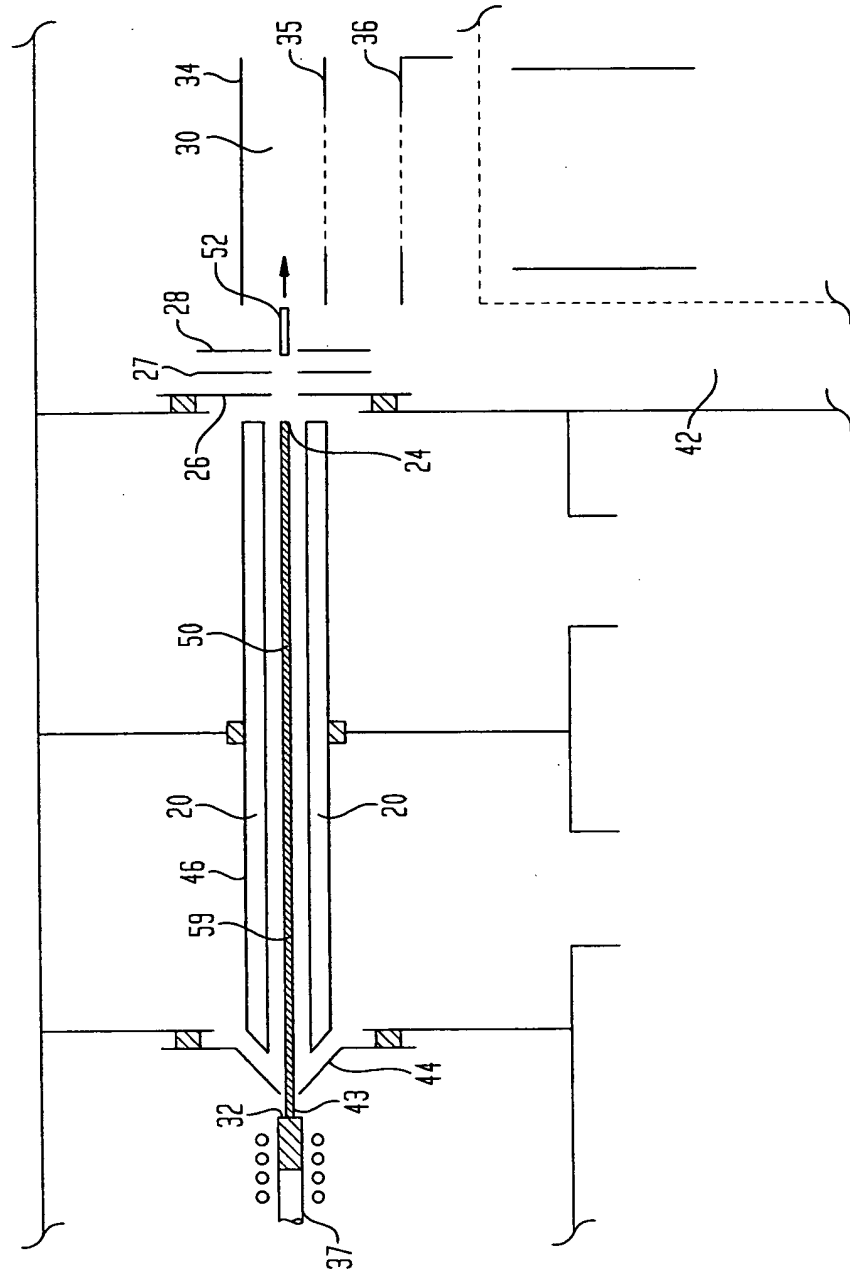


FIG. 3
(PRIOR ART)

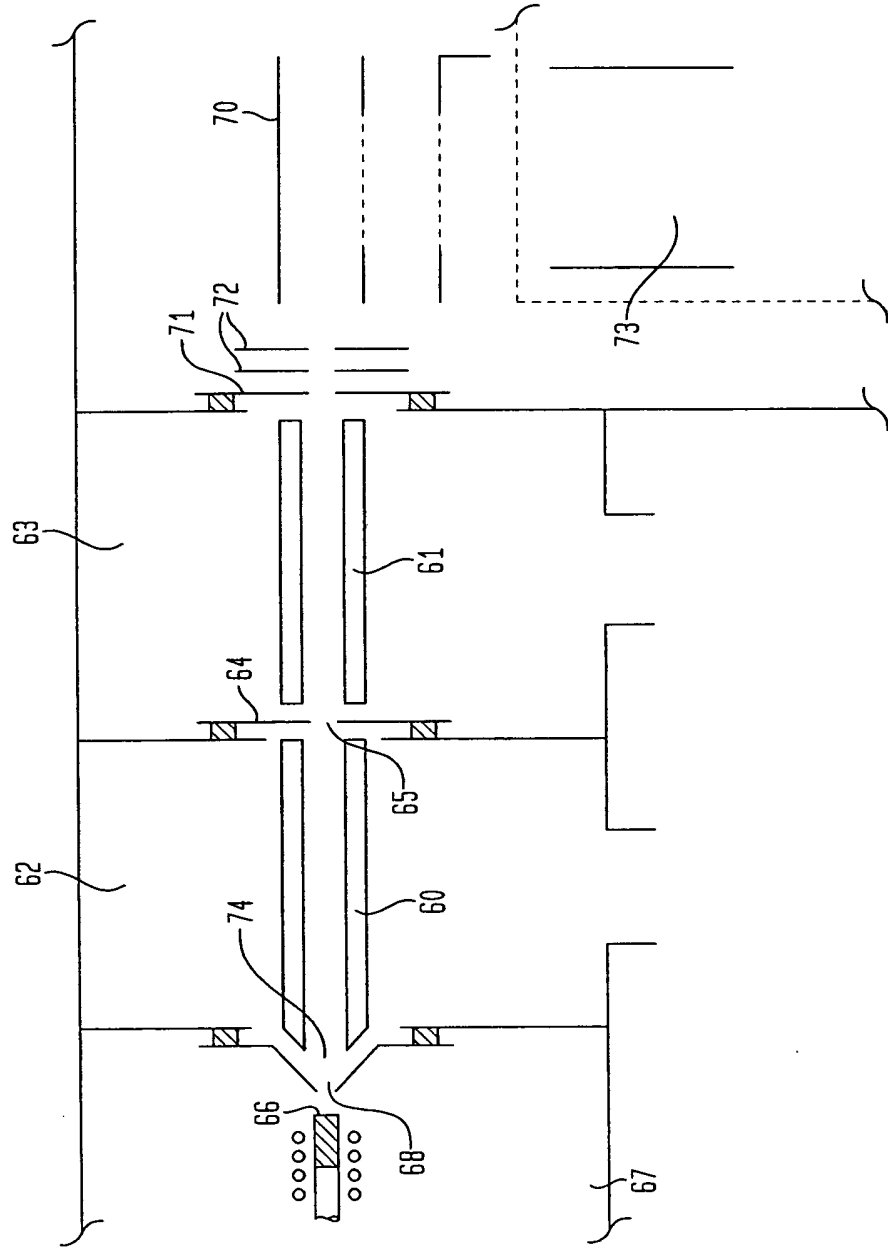


FIG. 4
(PRIOR ART)

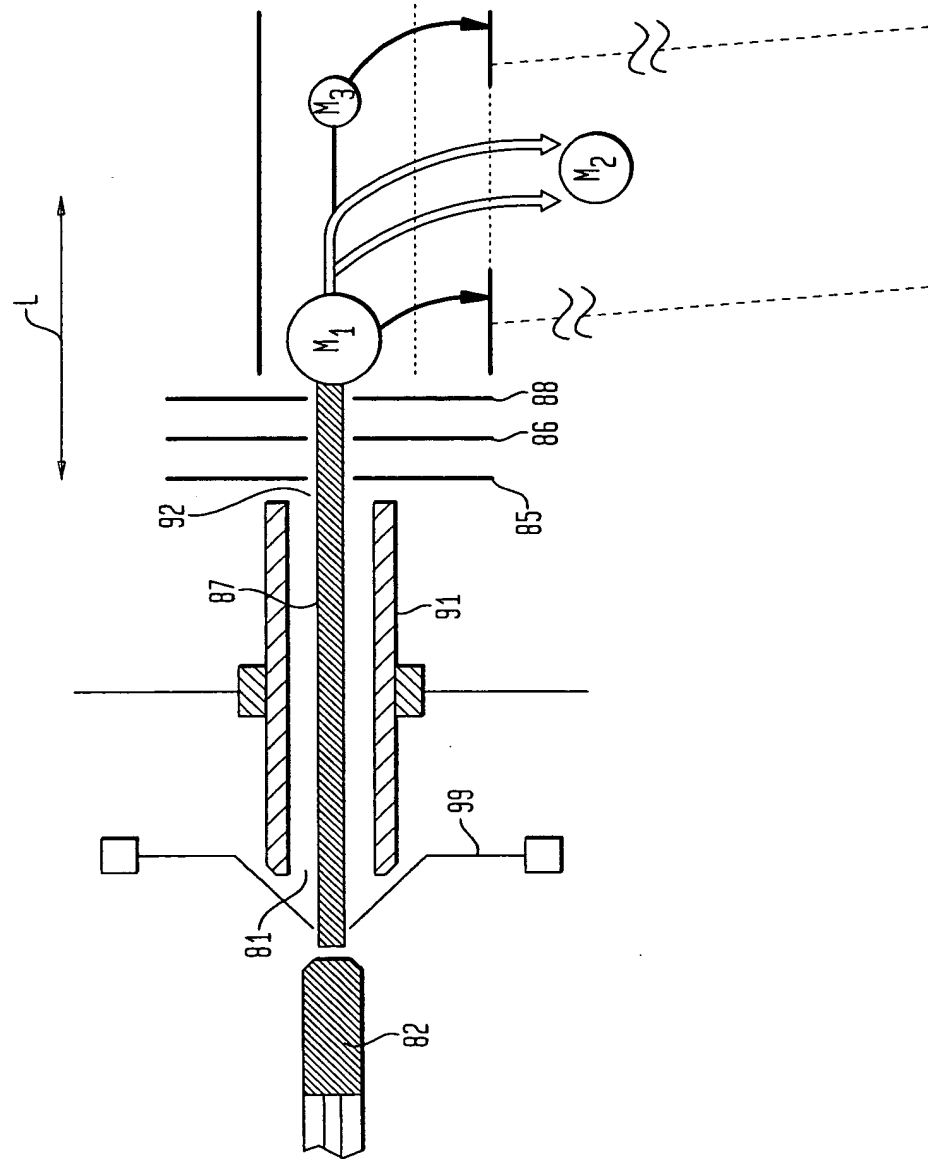


FIG. 5
(PRIOR ART)

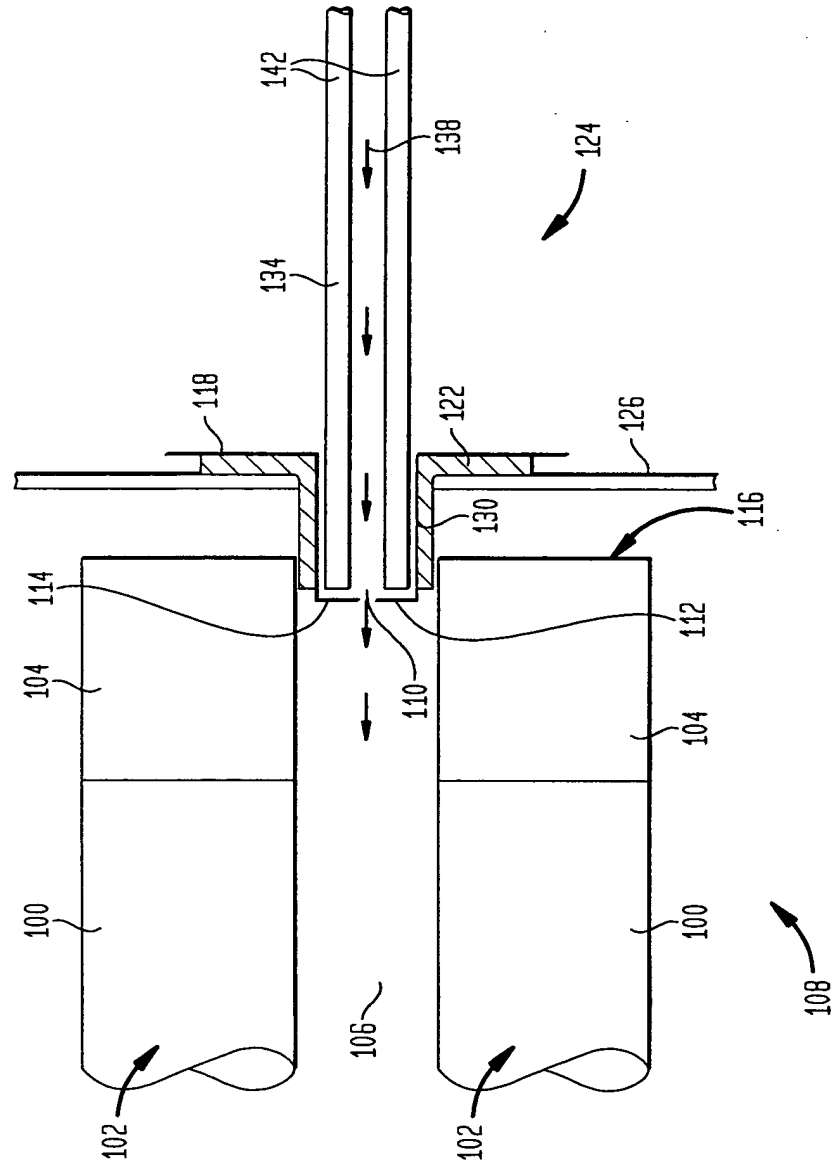


FIG. 6

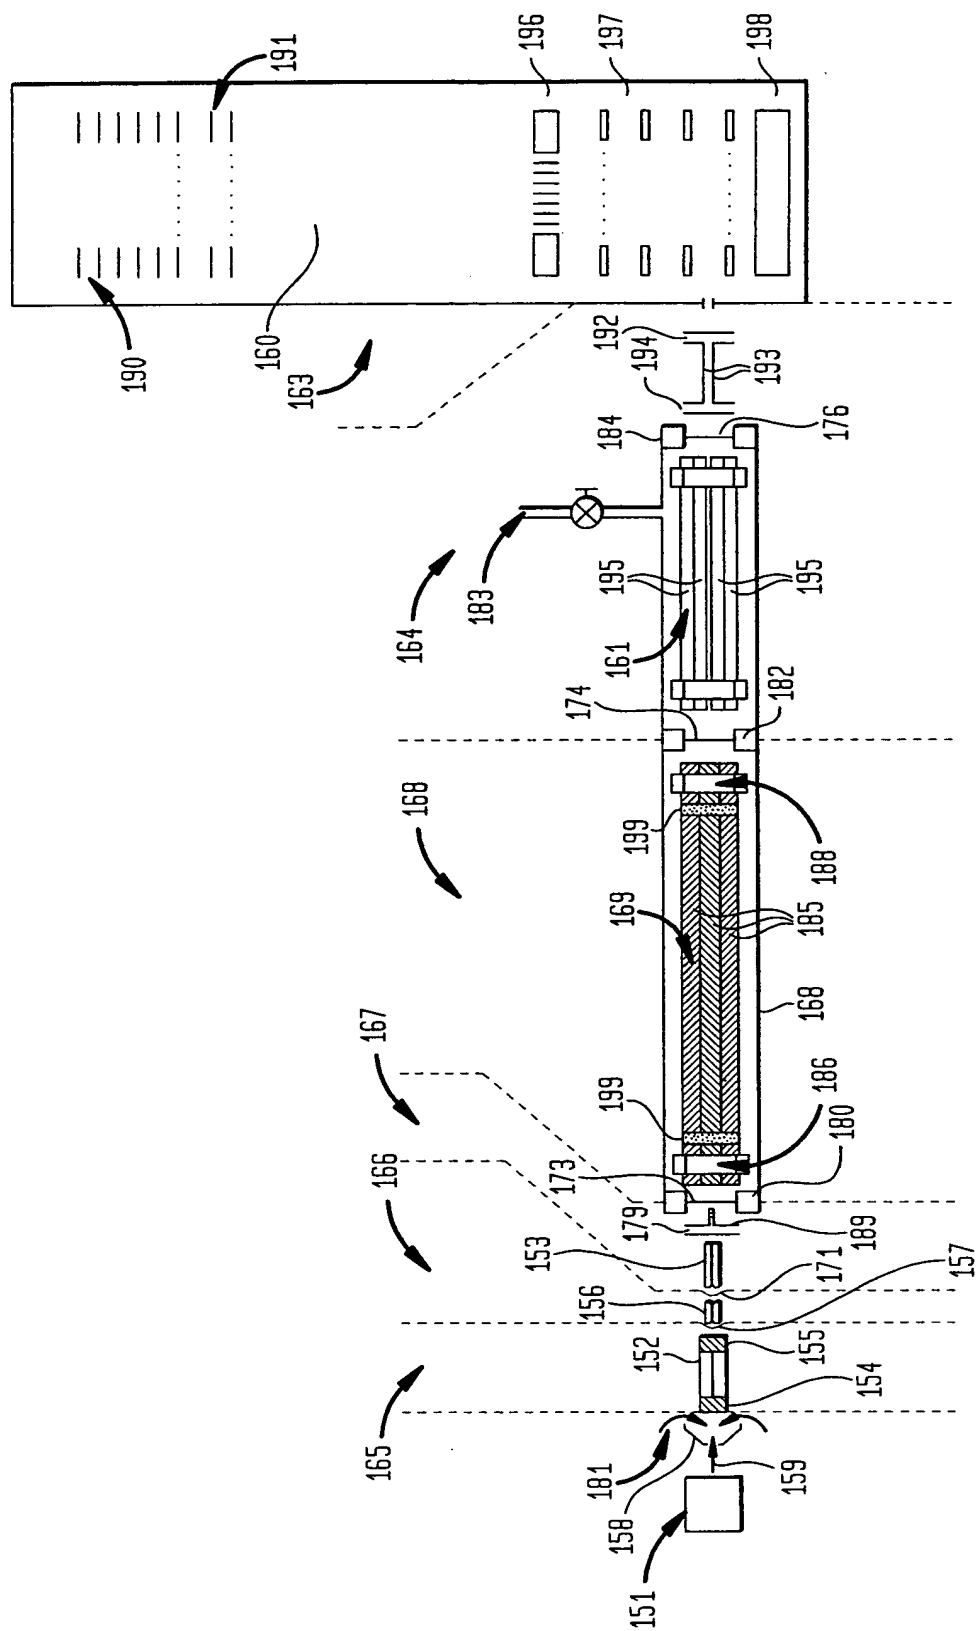


FIG. 7

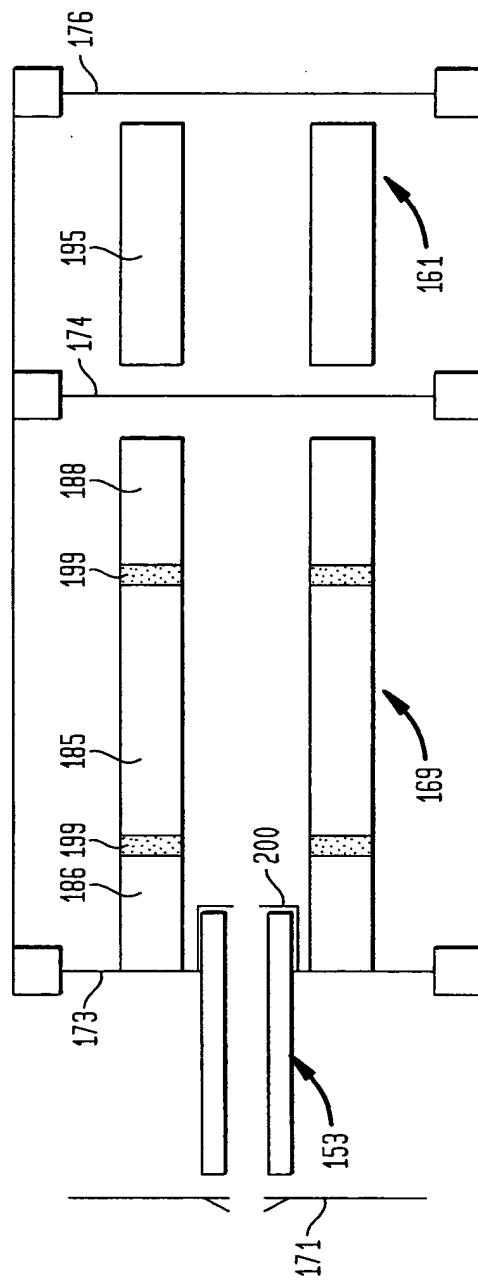


FIG. 8


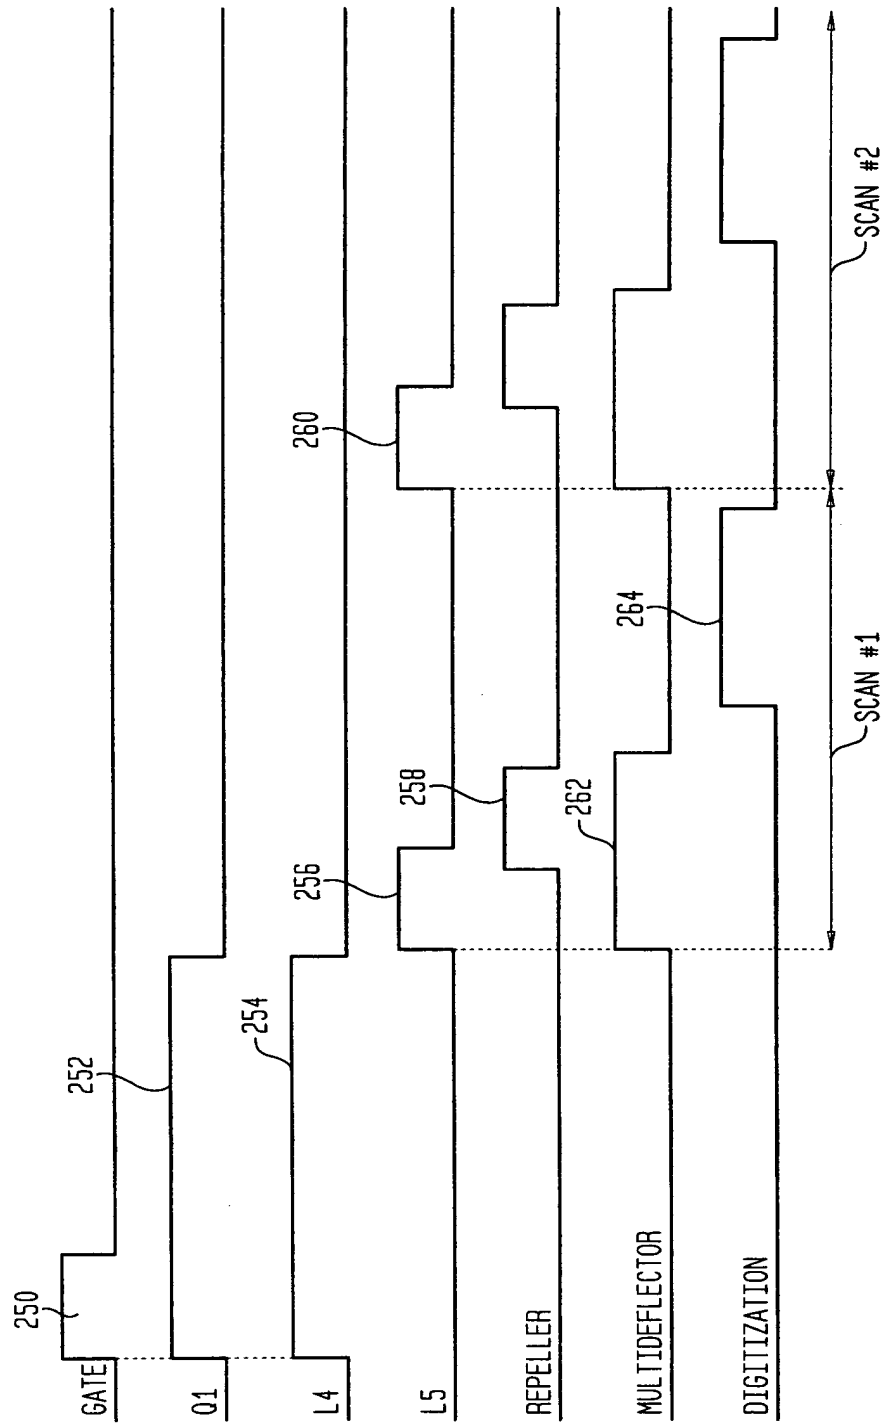


FIG. 9

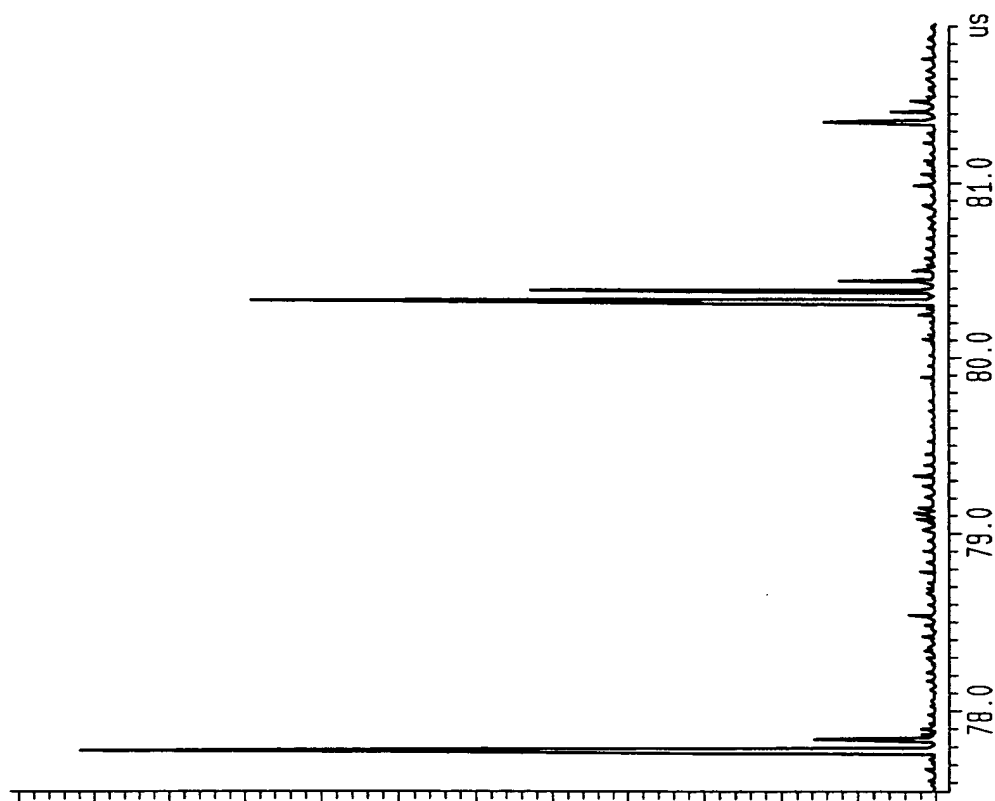

INSTRUM BioTOF-Lite NT
 OpId tof
 SMPNAM BioTOF Sample
 AQ_DATE Tue Oct 17 12:57:34 2000
 OS9PATH /h0/t/data
 POLARI NEG
 AQOP_m Reflector
 TD 203567
 NoSHOTS 500
 SMONUM 0
 SMOPTS1 0
 SMOPTS2 0
 SMOPTS3 0
 DW 2.00 (us)
 AccE 0.00 (kV)
 RefLE 7.90 (kV)
 RefFull 7.90 (kV)
 UdetL 0.00 (kV)
 UdetR 1.80 (kV)
 Udef1 2.00 (kV)
 PULSREP 3.00 (Hz)
 ML1 6687.800
 ML2 444.856
 ATTEN 0.0
 Parent 1047.20 (us)
 PULSTART1 0.00 (us)
 PULSDUO 0.00 (us)
 PULSDUR1 0.00 (us)
 CM1 Do you really want it?
 CM2 Do you really want 2 lines?

FIG. 10

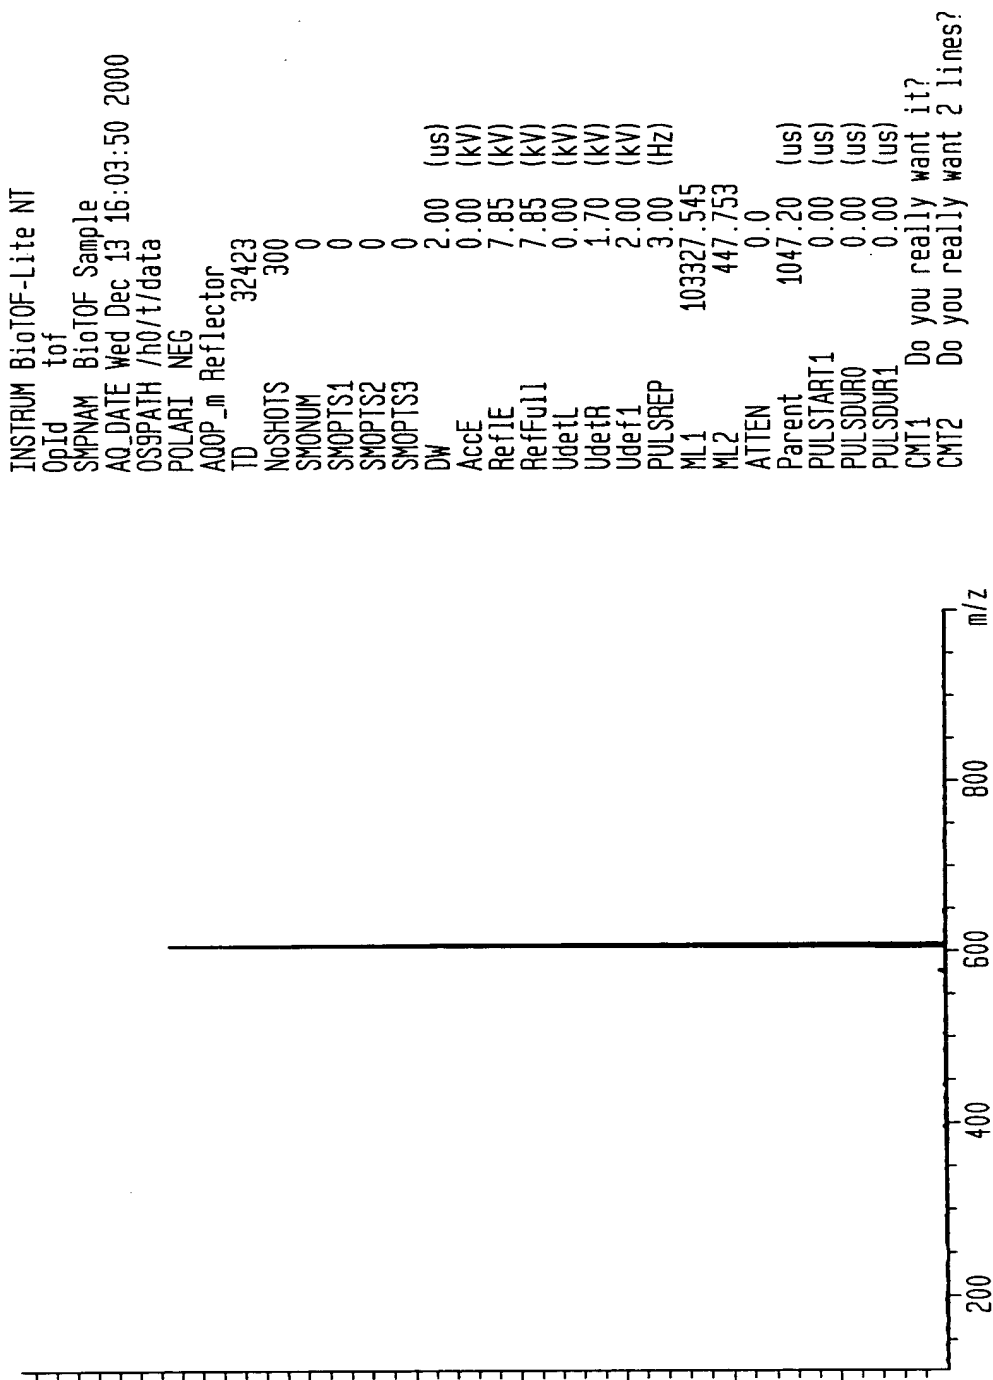


FIG. 11

